

TO BE CONSTRUCTED DE-ENERGISED UNLESS RISK ASSESSED

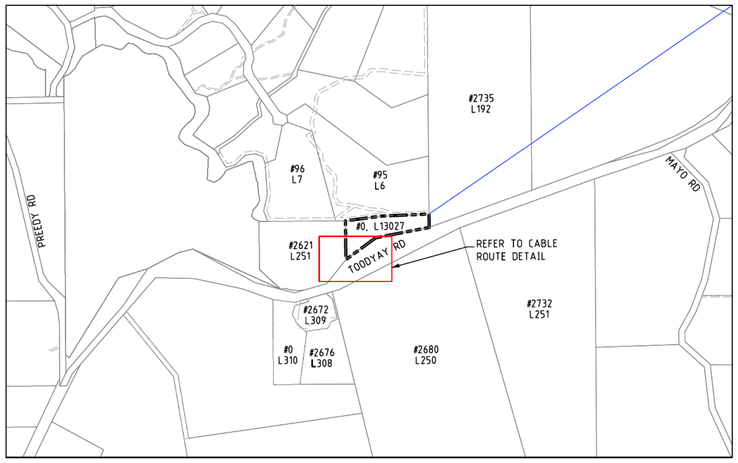


SITE LOCATION PLAN

1:10,000 200 100 0 200 400 600 800

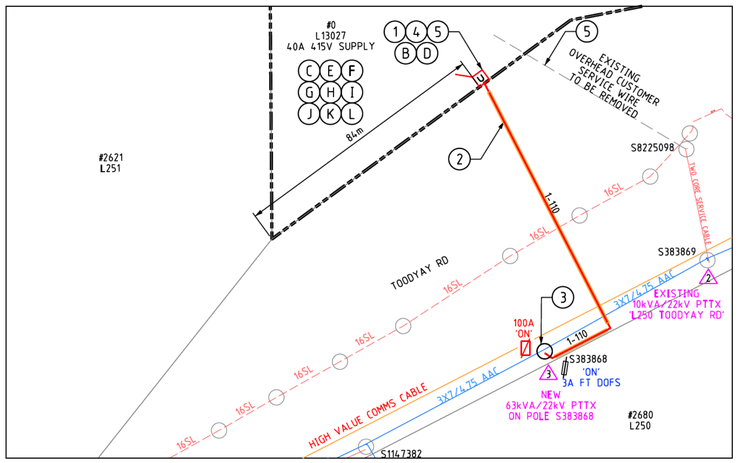


CABLE ROUTE DETAIL

1:1000 20 10 0 20 40 60 80

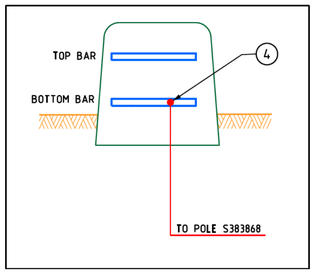

DETAIL A - UNI PILLAR
LOT 13027 TOODYAY RD

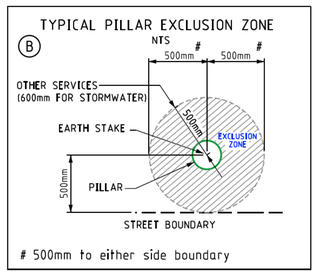

WESTERN POWER SCOPE OF WORK

EXCAVATION WARNING:
EXCAVATION CONTRACTOR TO FOLLOW THE CODE OF PRACTICE AND PROVIDE COMPETENT PERSON APPROVAL FOR WORK METHODOLOGY AND SOIL RETENTION STRATEGY.

NOTE TO CM:
POSSESSION OF SITE CERTIFICATE IS TO BE REQUESTED, AND MAIN ROADS DOCUMENT D18#604587 'SEEKING APPROVAL TO UNDERTAKE WORKS WITHIN THE ROAD RESERVE' TO BE COMPLETED.

CM TO COMPLY WITH SIGNED CONDITIONAL AGREEMENT-REFER VOLT ID# ID18-105975859-12584901

1. INSTALL NEW UNI PILLAR ON LOT 13027 TOODYAY RD AS PER TYPICAL PILLAR EXCLUSION ZONE AND CABLE ROUTE DETAIL.
   CU: LU11 x 1
   DCSM: U09
2. INSTALL NEW 240LV CABLE FROM NEW UNI PILLAR ON LOT 13027 TOODYAY RD TO POLE S383868. REFER TO CABLE ROUTE DETAIL.
   CU: CN45 x 135m, CN73_LVMAINS x 3, CN54 x 10
3. AT POLE S383868.
   REPLACE EXISTING POLE WITH NEW 12.5m/6kN POLE IN THE SAME LOCATION.
   INSTALL NEW 3PH HV INTERMEDIATE EXTENDED RAISER CROSSARM.
   INSTALL NEW DOF CROSSARM WITH 3 x 3A FT FUSES.
   INSTALL NEW 63kVA/22kV PTTX.
   TAP NEW PTTX HV BUSHINGS TO HV BARE WEST VIA DOF.
   INSTALL KRONE BOX WITH 100A LV FUSES.
   TERMINATE NEW 240LV CABLE ONTO PTTX LV BUSHINGS VIA NEW 100A KRONE FUSE.
   CU: P08_R x 1, HV21_3M x 1, HV20_3M x 1, HV52_3FT x 3, TX1_63/22 x 1, CN9_7/475AA x 3, LU61_240_3PO x 1, LU61_240_3PU x 1, CN18_7/475AA x 3, CN11_95 x 6, CN74_7/475 x 6, HV34_PT x 1, HV34_PT16 x 1.
   DCSM: H10-Z, U19-3, R8/3, R12-Z-1, R13-3
4. TERMINATE NEW 240LV CABLE ONTO THE BOTTOM BAR OF THE NEW UNI PILLAR ON LOT 13027 TOODYAY RD AND REFER TO CABLE ROUTE DETAIL AND DETAIL A.
   CU: LU7_240 x 1
5. REMOVE EXISTING OVERHEAD CUSTOMER SERVICE WIRE FROM POLES S383869 AND S8225098. CUSTOMER TO COORDINATE MAINS TERMINATION WITH PILLAR ENERGISATION AND OHCSW REMOVAL AS REQUIRED.
6. ENVIRONMENTAL FILTER CHECKED

   THE FOLLOWING ENVIRONMENTAL ISSUES HAVE BEEN IDENTIFIED FOR THIS PROJECT. ALL RELEVANT PERMITS / PROCEDURES MUST BE OBTAINED / ADHERED TO:

   1. VEGETATION:
   TO ENABLE THE CUSTOMER TO OBTAIN CLEARING APPROVALS, WESTERN POWER MUST PROVIDE THE CUSTOMER WITH A DRAWING SHEET OF THE VEGETATION CLEARING REQUIRED VEGETATION CLEARING TEMPLATE (SEE CAD CONFORM SEED FILES), ANY PHOTOS AND/OR SHAPEFILES SHOWING THE EXACT LOCATION(S) WHERE CLEARING IS REQUIRED.
   REFER TO CUSTOMER SCOPE OF WORK F.

   2. ACID SULFATE SOILS - DRAINAGE:
   THE GROUNDWATER AT THIS SITE IS UNKNOWN, NO DEWATERING IS PERMITTED WITHOUT AN ACID SULFATE SOILS & DEWATERING MANAGEMENT PLAN BEING IN PLACE AND COMPLIANCE WITH THE EXCAVATION AND TRENCHING PROCEDURE. ALL EXCAVATIONS TO BE BACKFILLED WITHIN 18 HOURS.

   3. DANGEROUS GOODS - HAZARDOUS CHEMICALS:
   THE PROPOSED WORKS INVOLVES THE REMOVAL OR INSTALLATION OF ASSETS ASSOCIATED WITH HAZARDOUS SUBSTANCES OR DANGEROUS GOODS. (E.G. SF6, CHEMICALLY TREATED WOOD POLES), WESTERN POWER CREWS SHOULD FOLLOW THE WESTERN POWER HAZARDOUS SUBSTANCES AND DANGEROUS GOODS WORK INSTRUCTION WHICH OUTLINES THE MINIMUM SAFETY, HEALTH AND ENVIRONMENTAL REQUIREMENTS ASSOCIATED WITH HANDLING, STORING, TRANSPORTING, AND DISPOSING OF HAZARDOUS SUBSTANCES AND DANGEROUS GOODS.

   4. CONSTRUCTION NOISE:
   STANDARD CONSTRUCTION NOISE MANAGEMENT MEASURES APPLY. IF THE PROPOSED WORKS ARE TO BE UNDERTAKEN OUTSIDE OF 0700 - 1900 ON ANY OTHER DAY WHICH IS NOT A SUNDAY OR A PUBLIC HOLIDAY AND/OR ARE LOCATED NEAR MAJOR SENSITIVE RECEIVERS, CONSULTATION WITH THE LOCAL GOVERNMENT AUTHORITY WILL BE REQUIRED TO DETERMINE MITIGATION MEASURES AND REQUIREMENTS FOR A NOISE MANAGEMENT PLAN.

   5. INFRASTRUCTURE - ROADS, GAS, RAIL:
   1. FOR WORKS PROPOSED IN AN MRWA-CONTROLLED ROAD:
   WORKS ARE PROPOSED WITHIN TOODYAY ROAD STATE GOVERNMENT ROAD RESERVE.
   AN INITIAL NOTIFICATION OF WORKS IN WRITING MUST BE SUBMITTED TO MAIN ROADS WESTERN AUSTRALIA (MRWA) OUTLINING THE PROPOSED WORKS THAT WILL RESULT IN THE NEED TO ACCESS A ROAD RESERVE UNDER MRWA CONTROL.
   A UTILITY SERVICES MANAGEMENT AGREEMENT (USMA) MAY BE REQUIRED IF THE WORKS ARE WITHIN A CONTROL OF ACCESS ROAD, A STATE ROAD IN A RURAL / REGIONAL AREA OR WITHIN A BRIDGE / STRUCTURE. THIS WILL INCLUDE COMMERCIAL AND LEGAL OBLIGATIONS WHICH WILL REQUIRE REVIEW AND ACCEPTANCE IN ACCORDANCE WITH THE AUTHORITY TO EXECUTE DOCUMENTS.
   PREPARE AN INITIAL NOTIFICATION LETTER TO MRWA USING THE TEMPLATE (EDM 42754865). IN GENERAL, MRWA APPROVAL TO ACCESS MUST BE OBTAINED IN WRITING AT LEAST 15 WORKING DAYS BEFORE STARTING WORK. IF STIPULATED, ENSURE THE APPROVED AND FINAL DESIGN DRAWINGS ARE SENT TO MRWA AT THE COMPLETION OF THE WORKS.
   PRIOR TO EXECUTION AND IN ADDITION TO THE NOTIFICATION OF WORKS, THE PROJECT MANAGER MUST ALSO SUBMIT TO MRWA:
   - AN APPLICATION FORM FOR UTILITY SERVICE PROVIDERS
   - A TRAFFIC MANAGEMENT PLAN
   - SITE PHOTOS
   2. FOR WORKS PROPOSED IN A LOCAL GOVERNMENT ROAD RESERVE:
   FORMAL APPROVAL IS NOT REQUIRED HOWEVER A NOTIFICATION OF WORKS (EDM 34174076) SHALL BE SUBMITTED TO THE RELEVANT LOCAL GOVERNMENT AUTHORITY AT LEAST 10 DAYS BEFORE WORKS COMMENCE IN A LOCAL ROAD RESERVE (EXCLUDING INSPECTIONS).

PLEASE REFER TO THE ENVIRONMENTAL ADVICE IN THE VOLT FOR MORE INFORMATION.

CUSTOMER SCOPE OF WORK

A. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE WESTERN AUSTRALIAN SERVICE AND INSTALLATION REQUIREMENTS.

B. PILLAR EXCLUSION ZONE TO BE PREPARED AS PER THE WESTERN AUSTRALIAN SERVICE AND INSTALLATION REQUIREMENTS CLAUSE 12.5.3. THIS INCLUDES, BUT IS NOT LIMITED TO THE FOLLOWING:

1. PEGGING THE PILLAR LOCATION AND ADJACENT BOUNDARY LOCATION PRIOR TO CONSTRUCTION.

2. ONLY EASILY REMOVABLE SURFACE TREATMENT IS TO BE INSTALLED IN THIS AREA, SUCH AS BRICK PAVING.

3. CLEAR OF ALL SERVICES INCLUDING CONTAMINATED SOIL, ASBESTOS ETC.

4. LOCATED 300mm ABOVE 100 YEAR FLOOD LEVEL AND NOT IN A PRECARIOUS POSITION.

C. CUSTOMER IS RESPONSIBLE TO ARRANGE FOR WESTERN POWER ELECTRICAL CONTRACTOR SERVICE REQUEST OR AN APPROPRIATELY ACCREDITED ELECTRICAL CONTRACTOR, TO INSTALL DIRECT METERING IN THE SWITCHBOARD PRIOR TO SUPPLY BEING ENERGISED.

D. CUSTOMER IS RESPONSIBLE TO ARRANGE FOR AN APPROPRIATELY ACCREDITED ELECTRICAL CONTRACTOR TO INSTALL NEW CONSUMER MAINS TO THE NEW UNI PILLAR BACK BLOCKS. MAX SIZE CONSUMER MAINS THAT CAN BE TERMINATED IS 35mm2/PHASE.

E. CUSTOMER MUST COMPLY WITH POWER QUALITY LIMITS AS PER AS/NZS TS IEC 61000.3.5 AND WESTERN POWER TECHNICAL REQUIREMENTS.

F. CUSTOMER TO SMSB WITHIN 30m OF THE POINT OF SUPPLY (UNI PILLAR).

G. CUSTOMER TO REMOVE CUSTOMER POLE AFTER COMPLETION OF WORKS.

H. VEGETATION.
CUSTOMER IS RESPONSIBLE FOR OBTAINING ALL NECESSARY CLEARING APPROVALS AND, PRIOR TO WESTERN POWER COMMENCING WORKS, THE CUSTOMER IS REQUIRED TO PROVIDE A COPY OF EITHER:

- A CLEARING PERMIT ISSUED IN THE CUSTOMER×S NAME, OR
- A REFERRAL DETERMINATION NOTICE ISSUED BY DWER CONFIRMING A CLEARING PERMIT IS NOT REQUIRED BY THE CUSTOMER; OR
- WRITTEN DETAILS OF A RELEVANT CLEARING PERMIT EXEMPTION AND SUPPORTING DOCUMENTS (REGULATOR CORRESPONDENCE/LANDOWNER EXEMPTION CLEARING LETTER EDM 46147597)

THIS ALSO INCLUDES RELEVANT DEVELOPMENT APPROVALS FOR THE WORKS (I.E. BUILDING APPROVALS FOR A STRUCTURE THAT REQUIRES CLEARING TO CONSTRUCT). APPROVALS / EXEMPTIONS CAN BE SENT TO THE SEQT ENVIRONMENT TEAM VIA environment@westernpower.com.au FOR REVIEW AND SUITABILITY CONFIRMATION. ALLOW 10 BUSINESS DAYS FOR ENVIRONMENT TEAM TO REVIEW.

I. FAUNA.
CUSTOMER SHALL UNDERTAKE ANY NECESSARY FAUNA SURVEYS AND, IF REQUIRED, OBTAIN RELEVANT STATE / COMMONWEALTH APPROVALS FOR IMPACTS TO THIS SPECIES AND/OR ITS HABITAT. ALL SURVEYS, APPROVALS, AND RELEVANT MANAGEMENT ACTIONS SHALL BE PROVIDED TO WESTERN POWER FOR RECORD KEEPING AND REVIEW.

J. ABORIGINAL HERITAGE.
IT IS THE CUSTOMER'S RESPONSIBILITY TO COMPLETE THEIR OWN DUE DILIGENCE ASSESSMENT AND PROVIDE WESTERN POWER WITH THE EVIDENCE OF SURVEYS/CONSULTATIONS AND APPROVALS (WHERE APPLICABLE) PRIOR TO THE COMMENCEMENT OF WORKS.

K. LAND ACCESS.
WHERE/IF ASSETS ARE LOCATED ON PRIVATE PROPERTY NOT OWNED BY THE CUSTOMER AS PART OF THIS PROJECT, THE CUSTOMER IS REQUIRED TO PROVIDE EVIDENCE OF LAND ACCESS ARRANGEMENTS (E.G. A LEASE AGREEMENT SIGNED BY THE LANDOWNER) PRIOR TO THE COMMENCEMENT OF WORKS.

L. LAND USE PLANNING.
THE PROPOSED WORKS ARE OCCURRING ON LAND WHICH IS SUBJECT TO LAND USE PLANNING CONTROLS UNDER THE PERTH METROPOLITAN REGION SCHEME. THE CUSTOMER IS RESPONSIBLE FOR CONSULTING WITH THE CITY OF SWAN AND CONFIRMING AND SATISFYING ANY DEVELOPMENT APPLICATION (DA) REQUIREMENTS AND PROVIDING EVIDENCE TO WESTERN POWER.



LEGEND

HV CABLES
- CN53 - 400mm2 (3X1c)
- CN49 - 240mm2 (3X1c)
- CN48 - 185mm2 (3X1c)
- CN50 - 95mm2 (3X1c)
- CN51 - 50mm2 (3X1c)
- CN51 - 50mm2 (1c)
- CN46 - 35mm2 (3X1c)
- CN47 - 35mm2 (1c)
- EXISTING HV CABLES (SIZE AND TYPE INDICATED)

LV-SL CABLES
- CN45 - 240mm2 (1x3c)
- CN44 - 185mm2 (1x3c)
- CN43 - 120mm2 (1x3c)
- CN42 - 25mm2 (1x3c)
- CN41 - 16mm2 SL (1c)
- 40 C PILOT
- EXISTING LV CABLES (SIZE AND TYPE INDICATED)

PILLARS / PITS / ETC
- MINI (WORKING END)
- UNIVERSAL
- MINI
- LINK
- CABLE MARKER U/G
- UMS PIT
- UTILITIES PIT
- BGSP PIT
- 100/200AMP CUTOUT
- CONDUIT / POLY PIPE
- SLN Serviced Unclearned De-energised Lot

OH EQUIPMENT
- INTERMEDIATE
- PTS
- DOF
- HV ISOLATOR
- INLINE STRAIN
- LV DISCONNECTOR
- PTT
- ISOL TX
- AERIAL STAY
- OUTRIGGER STAY
- R RECLOSER
- GROUND STAY
- L LOAD BREAK SWITCH
- S SECTIONALISER
- C CAPACITOR
- LV ABC KRONE
- LBPTS
- SLB STREETLIGHT BOX

HV - AERIAL CONDUCTORS
- 19/3.25 AAC/AAAC
- 7/4.75 AAC/AAAC
- 7/2.5 AAC/AAAC
- 3/2.75 SCAC
- 6/1/3.00 AACSR/AC
- 150 HENDRIX
- EXISTING HV CONDUCTORS (SIZE AND TYPE INDICATED)

LV - AERIAL CONDUCTORS
- 19/3.25 AAC/AAAC
- 7/4.75 AAC/AAAC
- 7/2.5 AAC/AAAC
- LV ABC 95
- LV ABC 150
- SERVICE 16mm
- EXISTING LV CONDUCTORS (SIZE AND TYPE INDICATED)

ISSUED FOR CONSTRUCTION

NO NATIVE VEGETATION MAY BE DISTURBED WITHOUT A PERMIT OR OUTSIDE OF THE PERMIT AREA. IF IN DOUBT, PLEASE CONTACT THE RELEVANT MANAGER WHO WILL CONTACT WESTERN POWER ENVIRONMENTAL TEAM.

PLEASE NOTE: HEAVY PENALTIES MAY APPLY TO INDIVIDUALS AND BUSINESSES FOR DAMAGE TO NATIVE VEGETATION WITHOUT A PERMIT.

HIGH VALUE COMMS CABLE IN VICINITY OF WORKS

CONSULTANT CONTACT DETAILS
COMPANY NAME: [redacted]
CONTACT: [redacted] TEL: [redacted]

CUSTOMER CONTACT DETAILS
COMPANY NAME: CITY OF SWAN
CONTACT: [redacted] TEL: [redacted]

Rev.	REVISIONS	DRN	DATE	REFERENCE FILE DETAILS
				MRWA AGREEMENT VOLT ID#: ID18-105975859-12584901
				ENVIRONMENTAL ADIVCE VOLT ID#: ID18-105975859-12563952
A	ISSUED FOR CONSTRUCTION	I.D.	04/26	HMR VOLT ID#: ID18-105975859-12570923

COMMERCIAL SUPPLY UPGRADE
1 x 40A 415V SUPPLY
LOT 13027, TOODYAY RD GIDGEGANNUP WA 6083
NETWORK VOLTAGE: 22kV / 415V

DESIGNER: CUSTOMER CONNECTION DESIGN
DESIGN TEAM: [redacted]
EMAIL: [redacted]
TEL: [redacted]
DATE: 04/26 SCALE: AS NOTED @ A1
GEO REF: Lat. - 31°46'08" S Long. - 116°14'32" E

western power

DRAWING NUMBER
MP219401
SHEET 01 OF 02
REV: A ORIGINAL SIZE - A1

TO BE CONSTRUCTED DE-ENERGISED UNLESS RISK ASSESSED



DETAIL A

1:1000 20 10 0 20 40 60 80

CLEARING AREA-SURVEY PEG SCHEDULE

POINT ID	CLEARING AREA	SURVEY PEG LOCATION	
		EASTING	NORTHING
A	AREA 1	428258.736	6484919.170
B	AREA 1	428265.190	6484923.898
C	AREA 1	428263.464	6484912.717
D	AREA 1	428269.917	6484917.444
E	AREA 2	428270.639	6484903.433
F	AREA 2	428273.307	6484904.804
G	AREA 2	428285.738	6484874.064
H	AREA 2	428288.406	6484875.435
I	AREA 3	428296.058	6484853.989
J	AREA 3	428298.726	6484855.361
K	AREA 3	428304.573	6484837.425
L	AREA 3	428307.241	6484838.797

CRITICAL RISK MANAGEMENT

NO DESIGN CHANGES
WITHOUT MANAGER APPROVAL

VEGETATION INSTRUCTION

WITH REGARD TO YOUR REQUESTED WORKS, IT HAS BEEN IDENTIFIED BY WESTERN POWER THAT CLEARING OR POTENTIAL CLEARING IS REQUIRED TO FACILITATE THE CONNECTION. BEING A CUSTOMER-FUNDED PROJECT, THE CUSTOMER IS RESPONSIBLE FOR OBTAINING ALL NECESSARY CLEARING APPROVALS PRIOR TO THE COMMENCEMENT OF WORKS. YOU CAN ENGAGE AN ENVIRONMENTAL CONSULTANCY TO ASSIST WITH THIS.

THE DEPARTMENT OF WATER AND ENVIRONMENTAL REGULATION (DWER) ADMINISTERS THE CLEARING PROVISIONS OF THE ENVIRONMENTAL PROTECTION ACT 1986 (EP ACT). UNDER THE EP ACT, A CLEARING PERMIT IS REQUIRED TO AUTHORISE CLEARING OF NATIVE VEGETATION UNLESS A VALID EXEMPTION APPLIES OR DWER IDENTIFIES THAT A CLEARING PERMIT IS NOT REQUIRED VIA THE FORMAL CLEARING REFERRAL PROCESS. WHILE CLEARING PERMIT APPLICATIONS ATTRACT FEES, YOU DO NOT HAVE TO PAY A FEE TO SUBMIT A REFERRAL. WHEN APPLYING TO DWER ENSURE THAT THE FOLLOWING WORDING IS INCLUDED IN THE RELEVANT FORMS:

"ALL OTHER CONSTRAINTS HAVE BEEN CONSIDERED AND CLEARING WAS DEEMED THE MOST SIGNIFICANT IMPACT. METHODS TO AVOID AND MINIMISE CLEARING CONSIDERED DURING THE DESIGN PHASE INCLUDED;

1. PLACEMENT OF LAYDOWN AREAS, TURNAROUNDS ETC. IN PREVIOUSLY CLEARED LAND
2. UTILISATION OF EXISTING ACCESS TRACKS WHERE POSSIBLE
3. RESTRICTION OF WORKS TO EXISTING MAINTENANCE ZONE WHERE POSSIBLE
4. UTILISATION OF PRUNING INSTEAD OF CLEARING WHERE POSSIBLE
5. UTILISATION OF FARMER'S PADDOCKS AND PREVIOUSLY CLEARED AREAS WHERE POSSIBLE
6. UNDERGROUNDING OF CABLES AND DRILLING INSTEAD OF TRENCHING
7. SELECTION OF JOINT AND ENTRY/EXIT HOLE LOCATIONS TO AVOID CLEARING OF (HIGH VALUE) VEGETATION
8. EARLY AND CONTINUAL ENGAGEMENT WITH WESTERN POWER ENVIRONMENT TEAM TO HIGHLIGHT PROPOSED RISKS AND AVOID WHERE POSSIBLE
9. USING LARGER LINE SPANS THAT CAN SPAN OVER VEGETATION
10. USING STRUCTURES WITH SMALLER FOOTPRINTS
11. IMPLEMENTING LOWER IMPACT CLEARING METHODOLOGIES, FOR EXAMPLE HAND CLEARING INSTEAD OF MECHANICAL CLEARING"

REFER TO https://www.wa.gov.au/service/environment/environment-information-services/clearing-permits FOR FURTHER INFORMATION ON CLEARING APPROVAL REQUIREMENTS. ADVICE ON RELEVANT EXEMPTIONS CAN BE OBTAINED VIA "DWER'S GUIDE 1 - EXEMPTIONS AND REGULATIONS FOR CLEARING NATIVE VEGETATION" AND CLARIFICATION CAN BE SOUGHT VIA EMAILING DWER DIRECTLY VIA info@dwer.wa.gov.au.

DETAIL A OF 220m2 IS THE AREA IN WHICH A CLEARING PERMIT IS REQUIRED, WHICH WILL ALLOW FOR THE WORKS TO PROCEED. THE AREA THAT IS DEFINED IS THE OPERATIONAL POTENTIAL IMPACT OF PERFORMING THE CONSTRUCTION WORKS. THIS PERMIT ALLOWS FOR INADVERTENT DESTRUCTION OF VEGETATION AND IS NOT REQUIRED BY THE LANDOWNER TO CLEAR PRIOR TO WORKS PROCEEDING.

PLEASE NOTE THAT DWER MAY IDENTIFY THAT THE CLEARING HAS SIGNIFICANT IMPACTS AND THERE MAY BE ADDITIONAL REQUIREMENTS BEFORE OR AFTER DWER ISSUE A CLEARING PERMIT THAT MAY IMPACT THE DELIVERY DATE. THESE MAY INCLUDE FLORA OR FAUNA SURVEY REQUIREMENTS AND HYGIENE MANAGEMENT PLANS.
PLEASE ENSURE YOU PROVIDE THE WESTERN POWER SCOPING SPECIALIST/CONSTRUCTION MANAGER WITH A COPY OF ONE OF THE FOLLOWING AS SOON AS PRACTICABLE FOR REVIEW AND SUITABILITY CONFIRMATION:

- A CLEARING PERMIT; OR
- A REFERRAL DETERMINATION NOTICE ISSUED BY DWER CONFIRMING A CLEARING PERMIT IS NOT REQUIRED; OR
- WRITTEN DETAILS OF A RELEVANT CLEARING PERMIT EXEMPTION AND SUPPORTING DOCUMENTS (INCLUDING ANY REGULATOR CORRESPONDENCE).

FURTHER RELEVANT AND SUPPORTING INFORMATION IS AVAILABLE VIA DWER'S WEBSITE. IF YOU HAVE ANY QUESTIONS ABOUT WESTERN POWER'S REQUIREMENTS, PLEASE CONTACT YOUR ALLOCATED DESIGNER.

LEGEND

HV CABLES
- CN53 - 400mm2 (3X1c)
- CN49 - 240mm2 (3X1c)
- CN48 - 185mm2 (3X1c)
- CN50 - 95mm2 (3X1c)
- CN51 - 50mm2 (3X1c)
- CN51 - 50mm2 (1c)
- CN46 - 35mm2 (3X1c)
- CN47 - 35mm2 (1c)
- EXISTING HV CABLES (SIZE AND TYPE INDICATED)

LV-SL CABLES
- CN45 - 240mm2 (1x3c)
- CN44 - 185mm2 (1x3c)
- CN43 - 120mm2 (1x3c)
- CN42 - 25mm2 (1x3c)
- CN41 - 16mm2 SL (1c)
- 40 C PILOT
- EXISTING LV CABLES (SIZE AND TYPE INDICATED)

PILLARS / PITS / ETC
- MINI (WORKING END)
- UMS PIT
- UNIVERSAL
- UTILITIES PIT
- MINI
- BGSP PIT
- LINK
- 100/200AMP CUTOUT
- CABLE MARKER U/G
- CONDUIT / POLY PIPE
- SUN Serviced Uncleared De-energised Lot

OH EQUIPMENT
- INTERMEDIATE
- PTS
- DOF
- HV ISOLATOR
- INLINE STRAIN
- LV DISCONNECTOR
- PTT
- ISOL TX
- AERIAL STAY
- OUTRIGGER STAY
- RECLOSER
- GROUND STAY
- LOAD BREAK SWITCH
- SECTIONALISER
- CAPACITOR
- LV ABC KRONE
- LBPTS
- STREETLIGHT BOX

HV - AERIAL CONDUCTORS
- 19/3.25 AAC/AAAC
- 7/4.75 AAC/AAAC
- 7/2.5 AAC/AAAC
- 3/2.75 SCAC
- 6/1/3.00 AACSR/AC
- 150 HENDRIX
- EXISTING HV CONDUCTORS (SIZE AND TYPE INDICATED)

LV - AERIAL CONDUCTORS
- 19/3.25 AAC/AAAC
- 7/4.75 AAC/AAAC
- 7/2.5 AAC/AAAC
- LV ABC 95
- LV ABC 150
- SERVICE 16mm
- EXISTING LV CONDUCTORS (SIZE AND TYPE INDICATED)

ISSUED FOR CONSTRUCTION

NO NATIVE VEGETATION MAY BE DISTURBED WITHOUT A PERMIT OR OUTSIDE OF THE PERMIT AREA. IF IN DOUBT, PLEASE CONTACT THE RELEVANT MANAGER WHO WILL CONTACT WESTERN POWER ENVIRONMENTAL TEAM.

PLEASE NOTE: HEAVY PENALTIES MAY APPLY TO INDIVIDUALS AND BUSINESSES FOR DAMAGE TO NATIVE VEGETATION WITHOUT A PERMIT.

HIGH VALUE COMMS CABLE IN VICINITY OF WORKS

CONSULTANT CONTACT DETAILS
COMPANY NAME: [redacted]
CONTACT: [redacted] TEL: [redacted]

CUSTOMER CONTACT DETAILS
COMPANY NAME: [redacted]
CONTACT: [redacted] TEL: [redacted]

Rev.	REVISIONS	DRN	DATE	FILE REFERENCE DETAILS
				MRWA AGREEMENT VOLT ID#: ID18-105975859-12584901
				ENVIRONMENTAL ADIVCE VOLT ID#: ID18-105975859-12563952
A	ISSUED FOR CONSTRUCTION	I.D.	04/26	HMR VOLT ID#: ID18-105975859-12570923

COMMERCIAL SUPPLY UPGRADE

1 x 40A SUPPLY

LOT 13027, TOODYAY RD GIDGEGANNUP WA 6083

NETWORK VOLTAGE: 22kV/415V

DESIGNER: CUSTOMER CONNECTION DESIGN
DESIGN TEAM: [redacted]
[redacted]
TEL: [redacted]
DATE: 04/26 SCALE: AS NOTED @ A2
GEO REF: Lat. - 31°46'08" S Long. - 116°14'32" E

western power

DRAWING NUMBER

MP219401

SHEET 02 OF 02

REV: A ORIGINAL SIZE - A2